


NOTES:

- (1) MAIN BODY OF HYDRANT MUST BE PAINTED ENTIRELY RED.
- (2) FIRE HYDRANT TO BE INSTALLED AT ROAD RIGHT-OF-WAY LINE OR EASEMENT LINE.
- (3) AREA AROUND HYDRANT AT A RADIUS OF 4' TO BE APPROXIMATELY LEVEL AND UNOBSTRUCTED.
- (4) WATERPROOF BAGS SHALL BE PLACED OVER ALL NEWLY INSTALLED FIRE HYDRANTS.

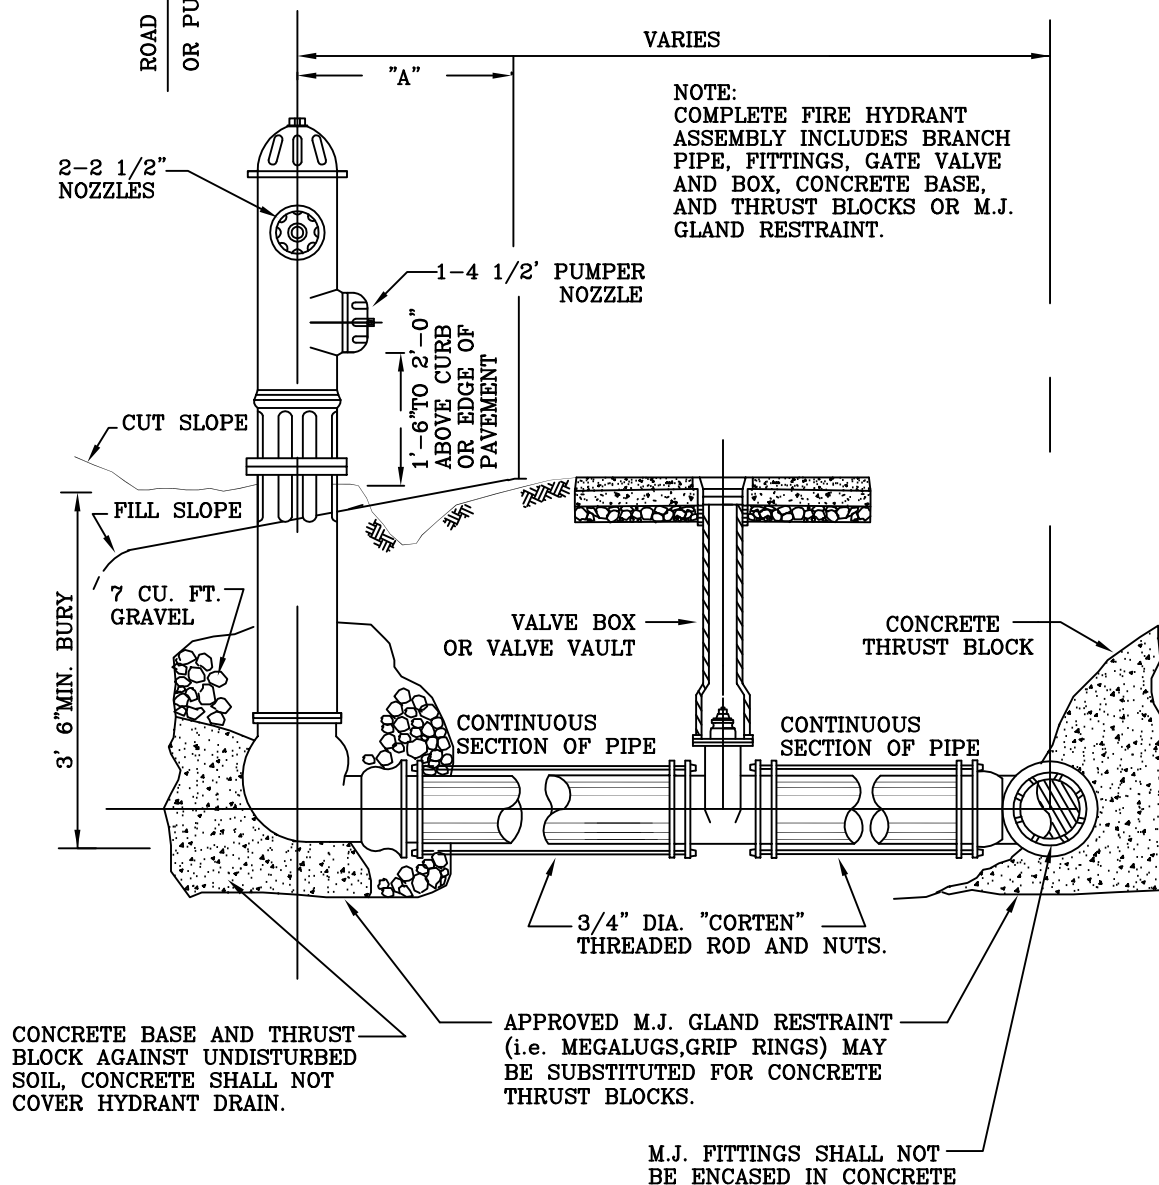

REVISIONS

NO.	DATE		
ORIGINAL	12/01/06		
1	10/25/07		

FIRE HYDRANT  
ASSEMBLY

DRAWING

W-18